


Asset Performance Statistics

Cathedral Rocks Australia

- Wind farm
- 66MW generation capacity
- Station fully commissioned in 2007
- Shareholding of 50% with operational control by CLP

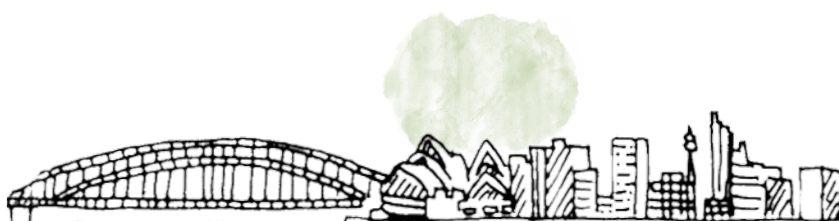

Parameter	Unit	2015	2014	2013	2012
1. Operation					
Electricity sent out	GWh	168	177	191	176
Availability Factor (AF) ⁽¹⁾	%	88.9	92.0	90.3	91.4
Capacity factor	%	29.7	31.4	33.9	31.2
2. Water ⁽²⁾					
Water Withdrawal	Mm ³	0	0	0	0
from marine water resources	Mm ³	0	0	0	0
from freshwater resources	Mm ³	0	0	0	0
from municipal sources	Mm ³	0	0	0	0
Water Discharged	Mm ³	0	0	0	0
treated wastewater discharged to sea	Mm ³	0	0	0	0
treated wastewater discharged to freshwater bodies	Mm ³	0	0	0	0
wastewater discharged to sewerage	Mm ³	0	0	0	0
Water Reused / Recycled	Mm ³	0	0	0	0
3. Environmental Compliance					
Regulatory non-compliances resulting in fines or prosecutions	No.	0	0	0	0
Licence limit exceedances & other non-compliances	No.	0	0	0	0

Asset Performance Statistics

Cathedral Rocks Australia

- Wind farm
- 66MW generation capacity
- Station fully commissioned in 2007
- Shareholding of 50% with operational control by CLP



Parameter	Unit	2015	2014	2013	2012
4. Waste Management ⁽³⁾					
Hazardous waste					
produced	T (solid) / kl (liquid)	1 / 2	1 / 10	3 / 4	0 / 0
recycled	T (solid) / kl (liquid)	0 / 2	0 / 10	0 / 4	0 / 0
disposed	T (solid) / kl (liquid)	1 / 0	1 / 0	3 / 0	0 / 0
Non-hazardous waste					
produced	T (solid) / kl (liquid)	26 / 0	27 / 0	28 / 0	16 / 2
recycled	T (solid) / kl (liquid)	3 / 0	5 / 0	4 / 0	1 / 2
disposed	T (solid) / kl (liquid)	23 / 0	22 / 0	24 / 0	15 / 0
5. Safety					
Employee - Fatalities	No.	0	0	0	0
Employee - Days lost / charged	Days	0	0	0	0
Employee - Lost Time Injuries ⁽⁴⁾	Cases	0	0	-	-
Employee - Occupational Disease ⁽⁴⁾	Cases	0	0	-	-
Employee - Total Work Hours ⁽⁴⁾	Manhours	2,308	3,239	-	-
Contractor - Fatalities ⁽⁴⁾	No.	0	0	-	-
Contractor - Lost Time Injuries ⁽⁴⁾	Cases	0	0	-	-
Contractor - Total Work Hours ⁽⁴⁾	Manhours	13,852	14,383	-	-

Notes:

(1) AF for wind farms = Total system available hours / Total length of period (hours) x 100.

(2) Rainwater tanks and septic tanks are used on site. Usage is not measured.

(3) Waste categorised in accordance with local regulations. Contractor waste is included.

(4) Started reporting in 2014.